

**Real Time Water Quality Monthly Report
Waterford River - St. John's NL
February 2007**

General

- Data from the Waterford River monitoring station is monitored by the Water Resources Management Division staff on a monthly basis.

Maintenance and Calibration of Instrumentation

- The following table displays the dates when the Datasonde was removed for routine cleaning, maintenance and calibration and when it was redeployed.

Table 1: Table of Datasonde removal and installation dates

Date Installed	Date Removed
	February 6, 2007
February 7, 2007	

- Water quality readings were taken with a Minisonde at the time of removal for comparison purposes. The Minisonde was calibrated prior to use.

Data Interpretation

- Areas in the graphs where the data lines go abruptly down to the x axis and show no readings occur when the datasonde is removed for routine cleaning, maintenance and calibration. The dates where this occurs correspond to Table 1 above.
- In general, water quality parameters were stable during the month of February with expected daily/nightly (diurnal) and seasonal changes occurring.
- Water temperatures remained near 0° throughout the month with some small fluctuations in response to daily maximum and minimum air temperatures. This is demonstrated by comparing the graph in **Figure 1** to the air temperature data in **Appendix 1**.

Figure 1



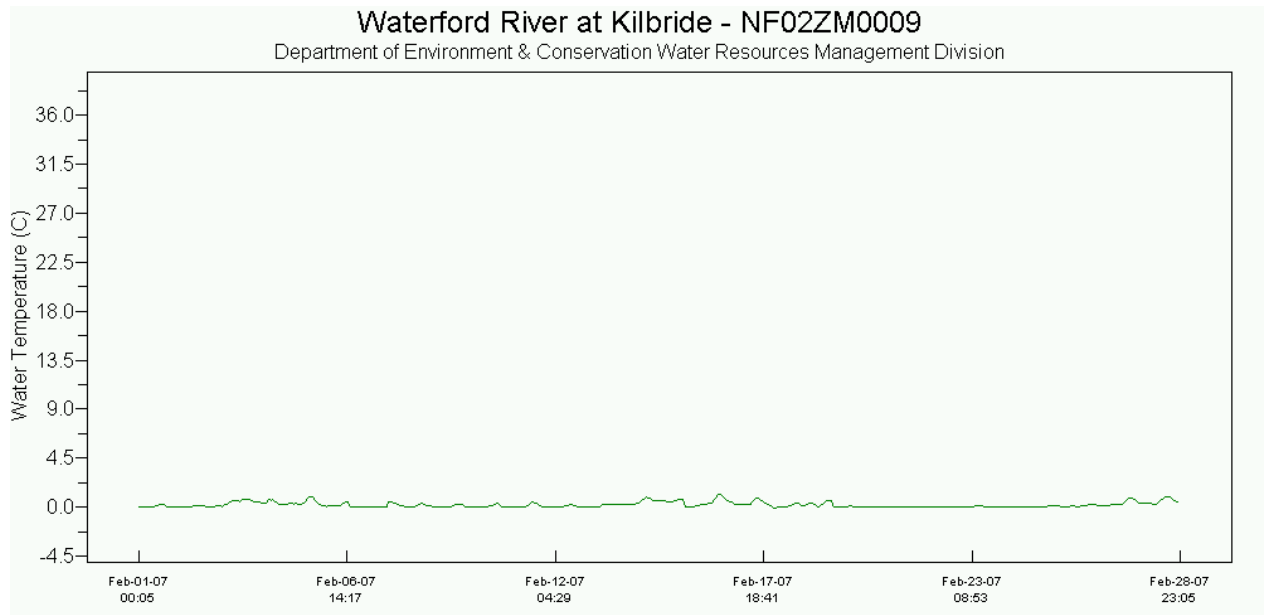


Figure 2

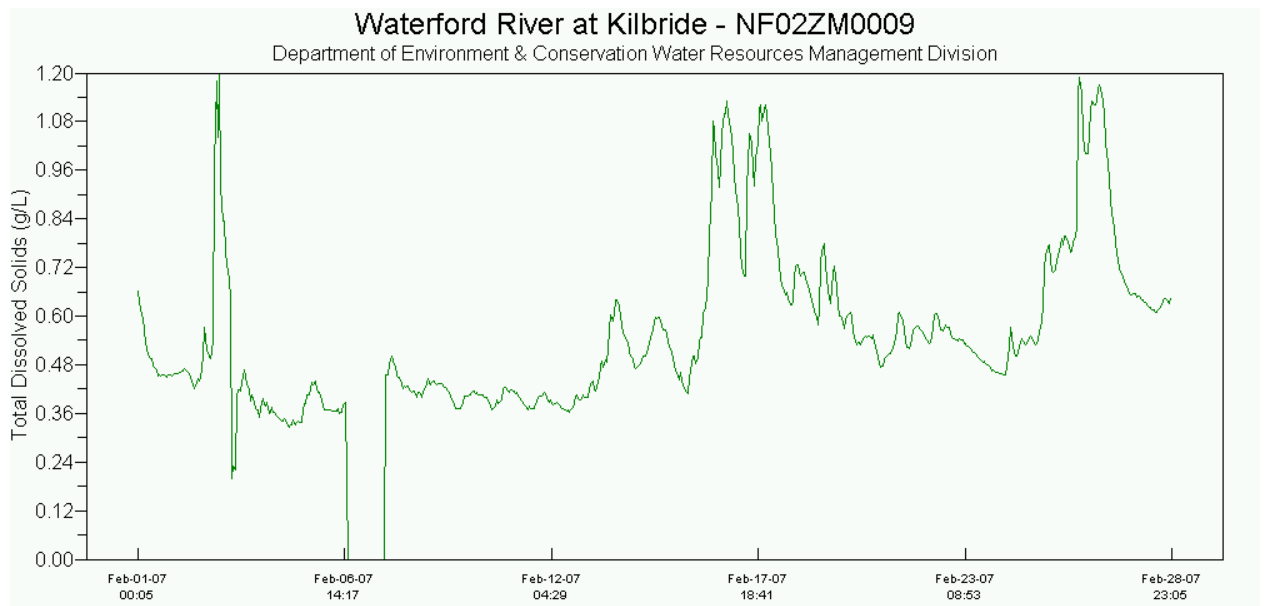


- Total dissolved solids levels reflected the changes in conductivity as observed in Figure 2. Conductivity measurements are a good indication of total dissolved solids and total dissolved ion concentrations, although this is not an exact linear relationship.

Figure 3

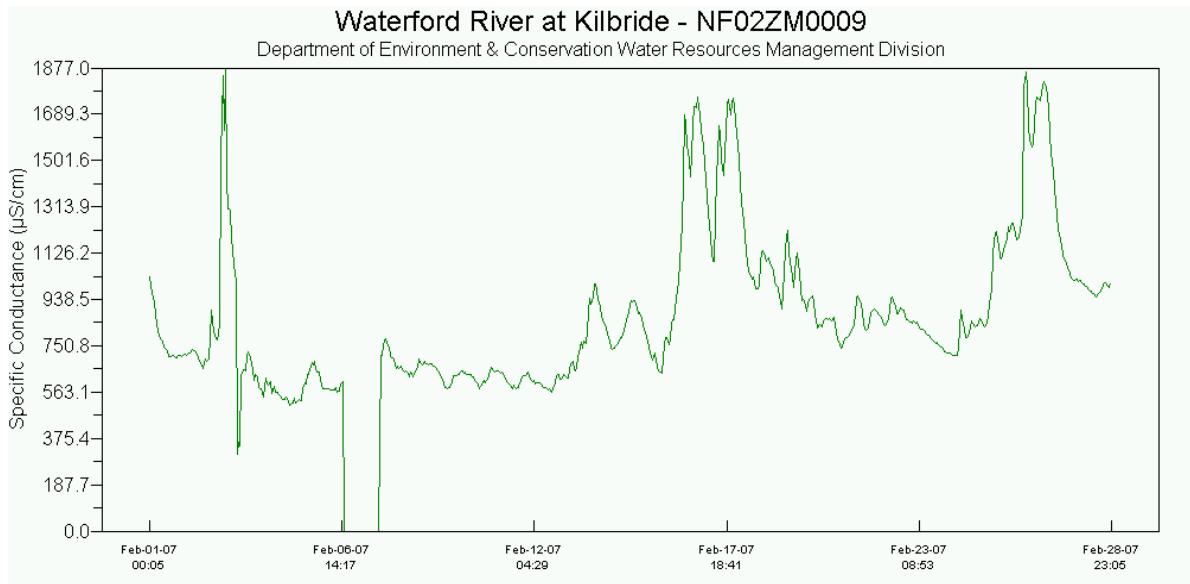


- Conductivity levels fluctuated throughout the month as observed in Figure 3.

Figure 4

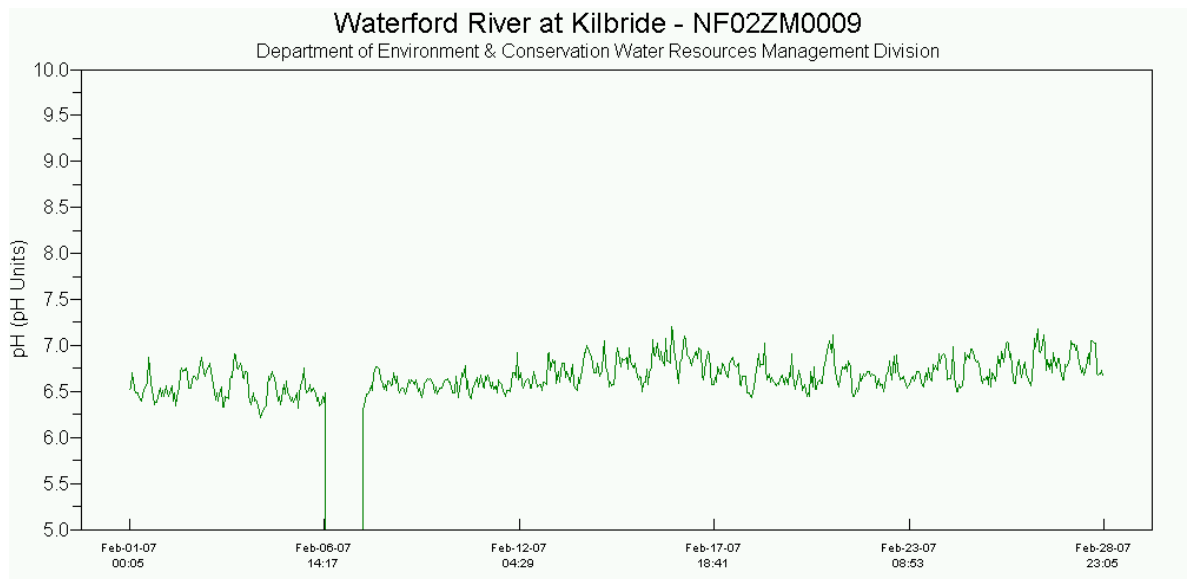


- The pH levels for the month of February were stable. There were some instances where the pH measurements were outside the CCME recommended Canadian Water Quality Guidelines for the Protection of Aquatic Life of 6.5 to 9 (Figure 4).

Figure 5

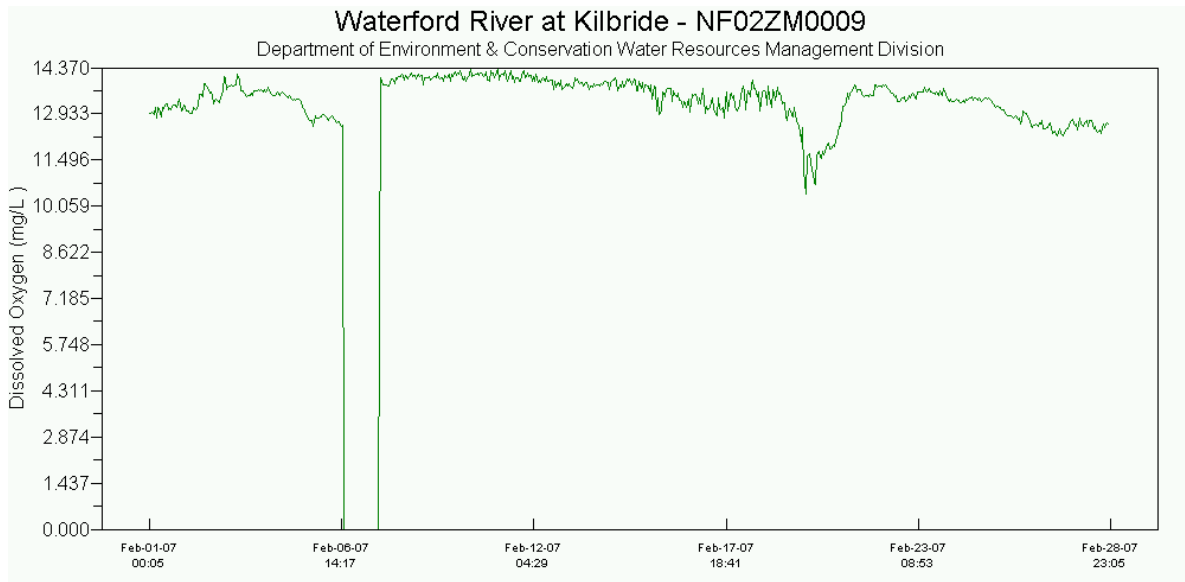


- Dissolved oxygen levels were stable during the period of measurement (Figure 5). The reduced DO measurements that occurred on approximately February 20 is likely related to the reduction in flow as observed in the stage graph in Figure 7.

Figure 6

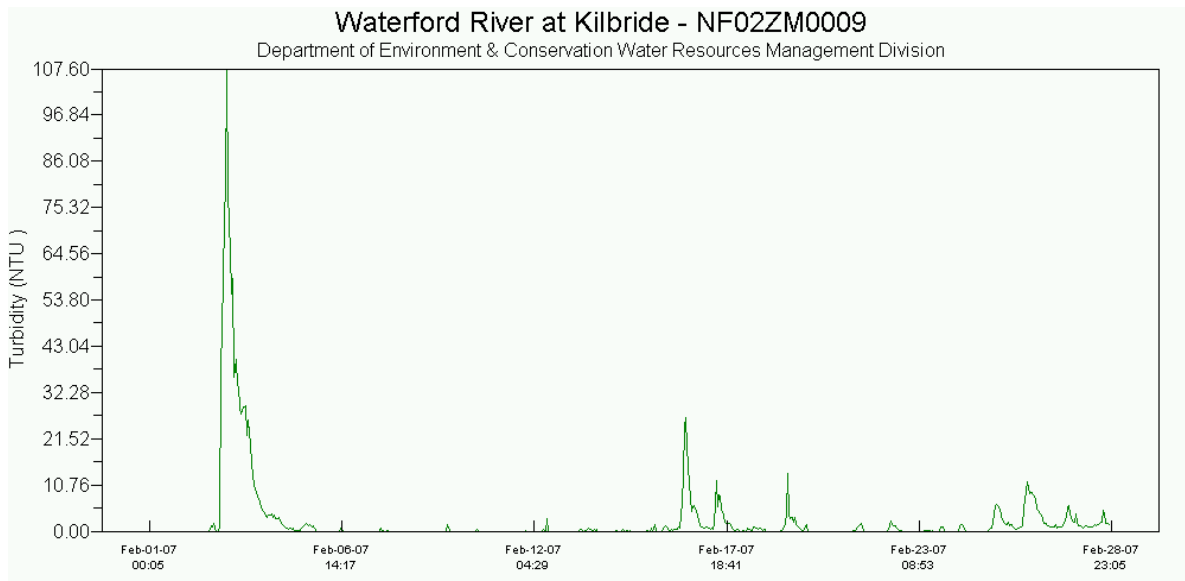

- Turbidity levels fluctuated and had several spikes noted throughout the month. The turbidity spikes (Figure 6) are normally in response to precipitation events. The high turbidity readings can be attributed to snow melt and subsequent runoff and precipitation events. Several turbidity spikes exceeded the CCME recommended maximum of 8 NTU above background levels.

Figure 7


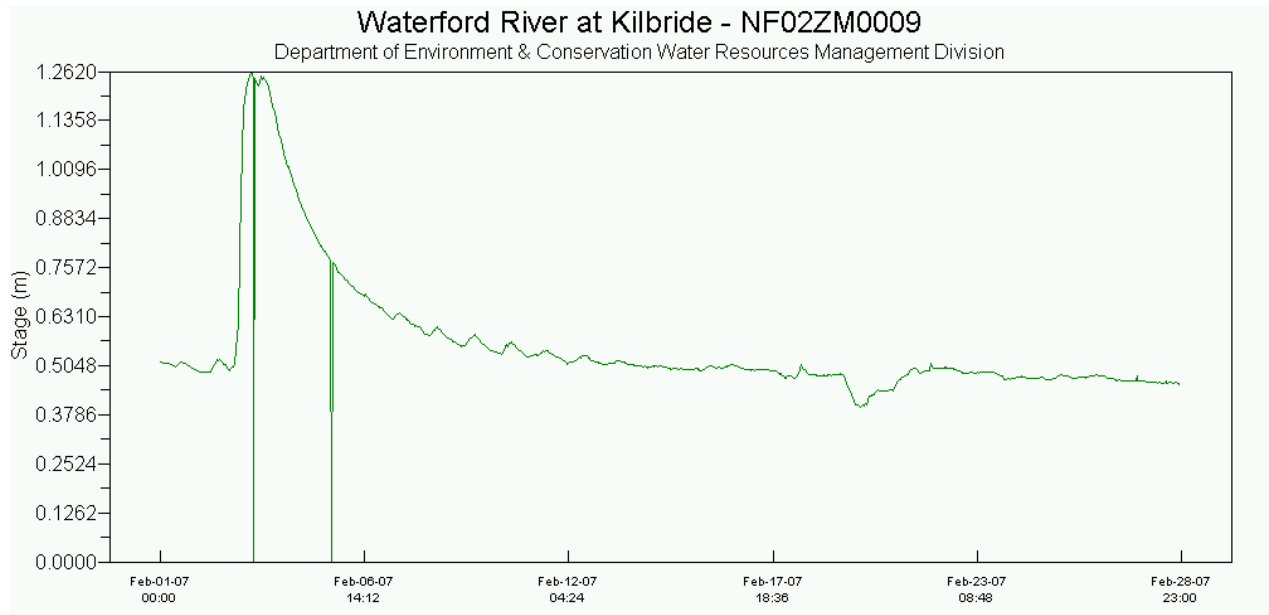









Report prepared by:

Kent Slaney
Environmental Scientist
Water Resources Management Division
Department of Environment and Conservation
Confederation Building West Block 4th Floor
PO Box 8700
St. John's NL A1B 4J6

Ph. (709) 729-1157
Fax (709) 729-0320

Appendix 1: Weather information for St. John's, NL provided by Environment Canada for February 2007

Daily Data Report for February 2007											
D a y	Max Temp °C 	Min Temp °C 	Mean Temp °C 	Heat Deg Days C 	Cool Deg Days C 	Total Rain mm 	Total Snow cm 	Total Precip mm 	Snow on Grnd cm 	Dir of Max Gust 10's Deg	Spd of Max Gust km/h
<u>01</u>	-7.4	-14.8	-11.1	29.1	0.0	0.0	T	T	30		
<u>02</u>	1.9	-13.0	-5.6	23.6	0.0	14.6	7.0	21.6	30		
<u>03</u>	4.5	-1.8	1.4	16.6	0.0	30.8	0.8	31.6	20		
<u>04</u>	-1.3	-8.3	-4.8	22.8	0.0	0.0	1.4	1.0	18		
<u>05</u>	-4.4	-11.9	-8.2	26.2	0.0	0.0	11.8	10.4	19		
<u>06</u>	-10.0	-15.1	-12.6	30.6	0.0	0.0	1.6	1.4	28		
<u>07</u>	-7.6	-12.7	-10.2	28.2	0.0	0.0	T	T	28		
<u>08</u>	-8.5	-13.7	-11.1	29.1	0.0	0.0	T	T	28		
<u>09</u>	-6.1	-15.5	-10.8	28.8	0.0	0.0	T	T	25		
<u>10</u>	-4.4	-15.5	-10.0	28.0	0.0	0.0	T	T	24		
<u>11</u>	-6.7	-11.3	-9.0	27.0	0.0	0.0	T	T	24		
<u>12</u>	-6.1	-9.4	-7.8	25.8	0.0	0.0	1.4	1.4	24		
<u>13</u>	-2.5	-8.5	-5.5	23.5	0.0	0.0	1.4	1.4	24		
<u>14</u>	-1.6	-5.5	-3.6	21.6	0.0	0.0	T	T	24		
<u>15</u>	1.2	-5.2	-2.0	20.0	0.0	0.8	5.8	10.6	23		
<u>16</u>	0.4	-7.2	-3.4	21.4	0.0	0.0	0.2	0.2	29		
<u>17</u>	-4.8	-11.2	-8.0	26.0	0.0	0.0	2.8	1.2	30		
<u>18</u>	-2.2	-11.2	-6.7	24.7	0.0	0.0	0.6	0.6	28		
<u>19</u>	-1.9	-4.0	-3.0	21.0	0.0	0.0	30.6	22.2	40		
<u>20</u>	-1.3	-7.2	-4.3	22.3	0.0	0.0	11.0	11.0	61		
<u>21</u>	-2.9	-7.9	-5.4	23.4	0.0	0.0	0.0	0.0	59		
<u>22</u>	-4.3	-10.8	-7.6	25.6	0.0	0.0	0.4	0.2	58		
<u>23</u>	-3.5	-13.5	-8.5	26.5	0.0	0.0	12.4	11.0	58		
<u>24</u>	-1.9	-5.1	-3.5	21.5	0.0	1.4	9.6	8.4	72		
<u>25</u>	0.6	-5.1	-2.3	20.3	0.0	0.0	2.0	1.4	74		
<u>26</u>	0.4	-2.5	-1.1	19.1	0.0	T	1.4	1.2	73		
<u>27</u>	-1.0	-3.7	-2.4	20.4	0.0	T	T	T	69		
<u>28</u>	-2.4	-5.1	-3.8	21.8	0.0	T	T	T	68		
Sum				674.9	0.0	47.6	102.2	136.8			